




# OVERHEAD DISTRIBUTION TRANSFORMER FUSE REPLACEMENT: THE HIDDEN COSTS THAT HURT YOUR BOTTOM LINE


THE PROBLEM



TRANSFORMER FUSE OPERATIONS ARE **70% NUISANCE** YET **100% NEED FIELD VISITS\***

The most common causes for overhead distribution transformer fuse operations are temporary. However, a blown fuse results in an unnecessary permanent outage and field visit.

**70%** OF SUSTAINED OUTAGES ARE AVOIDABLE THEREFORE **70%** OF O&M EXPENSES ARE AVOIDABLE

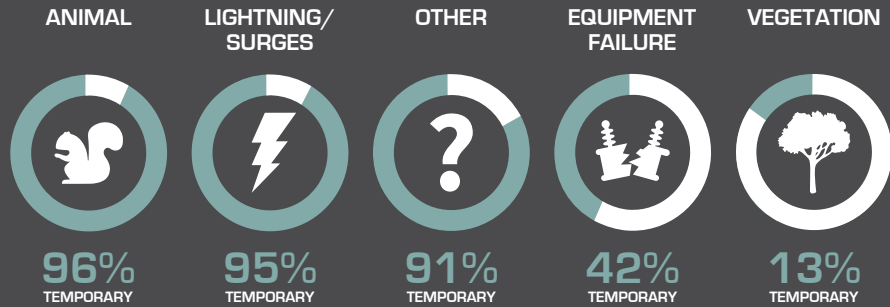

Imagine the service interruptions and expenses you could avoid if your protective devices could detect temporary faults.

THE OPPORTUNITY

THE COST

UNNECESSARY FIELD VISITS CAN **COST MILLIONS** OF DOLLARS EVERY YEAR

Every 100,000 transformers can require 3,300 unnecessary truck rolls to replace fuses. That equates to:

**3,300** UNNECESSARY SUSTAINED OUTAGES

**\$3,300,000** IN WASTED O&M EXPENSES FROM TRUCK ROLLS

**1,600** DAYS WASTED A YEAR

**66,000** EXTRA MILES DRIVEN PER YEAR

LEARN MORE AT [sandc.com](http://sandc.com)

Discover new technology that replaces transformer fuses and tests whether faults are temporary—saving you unnecessary outages and maintenance costs.

\*Data based on industry research and utility reporting.

